

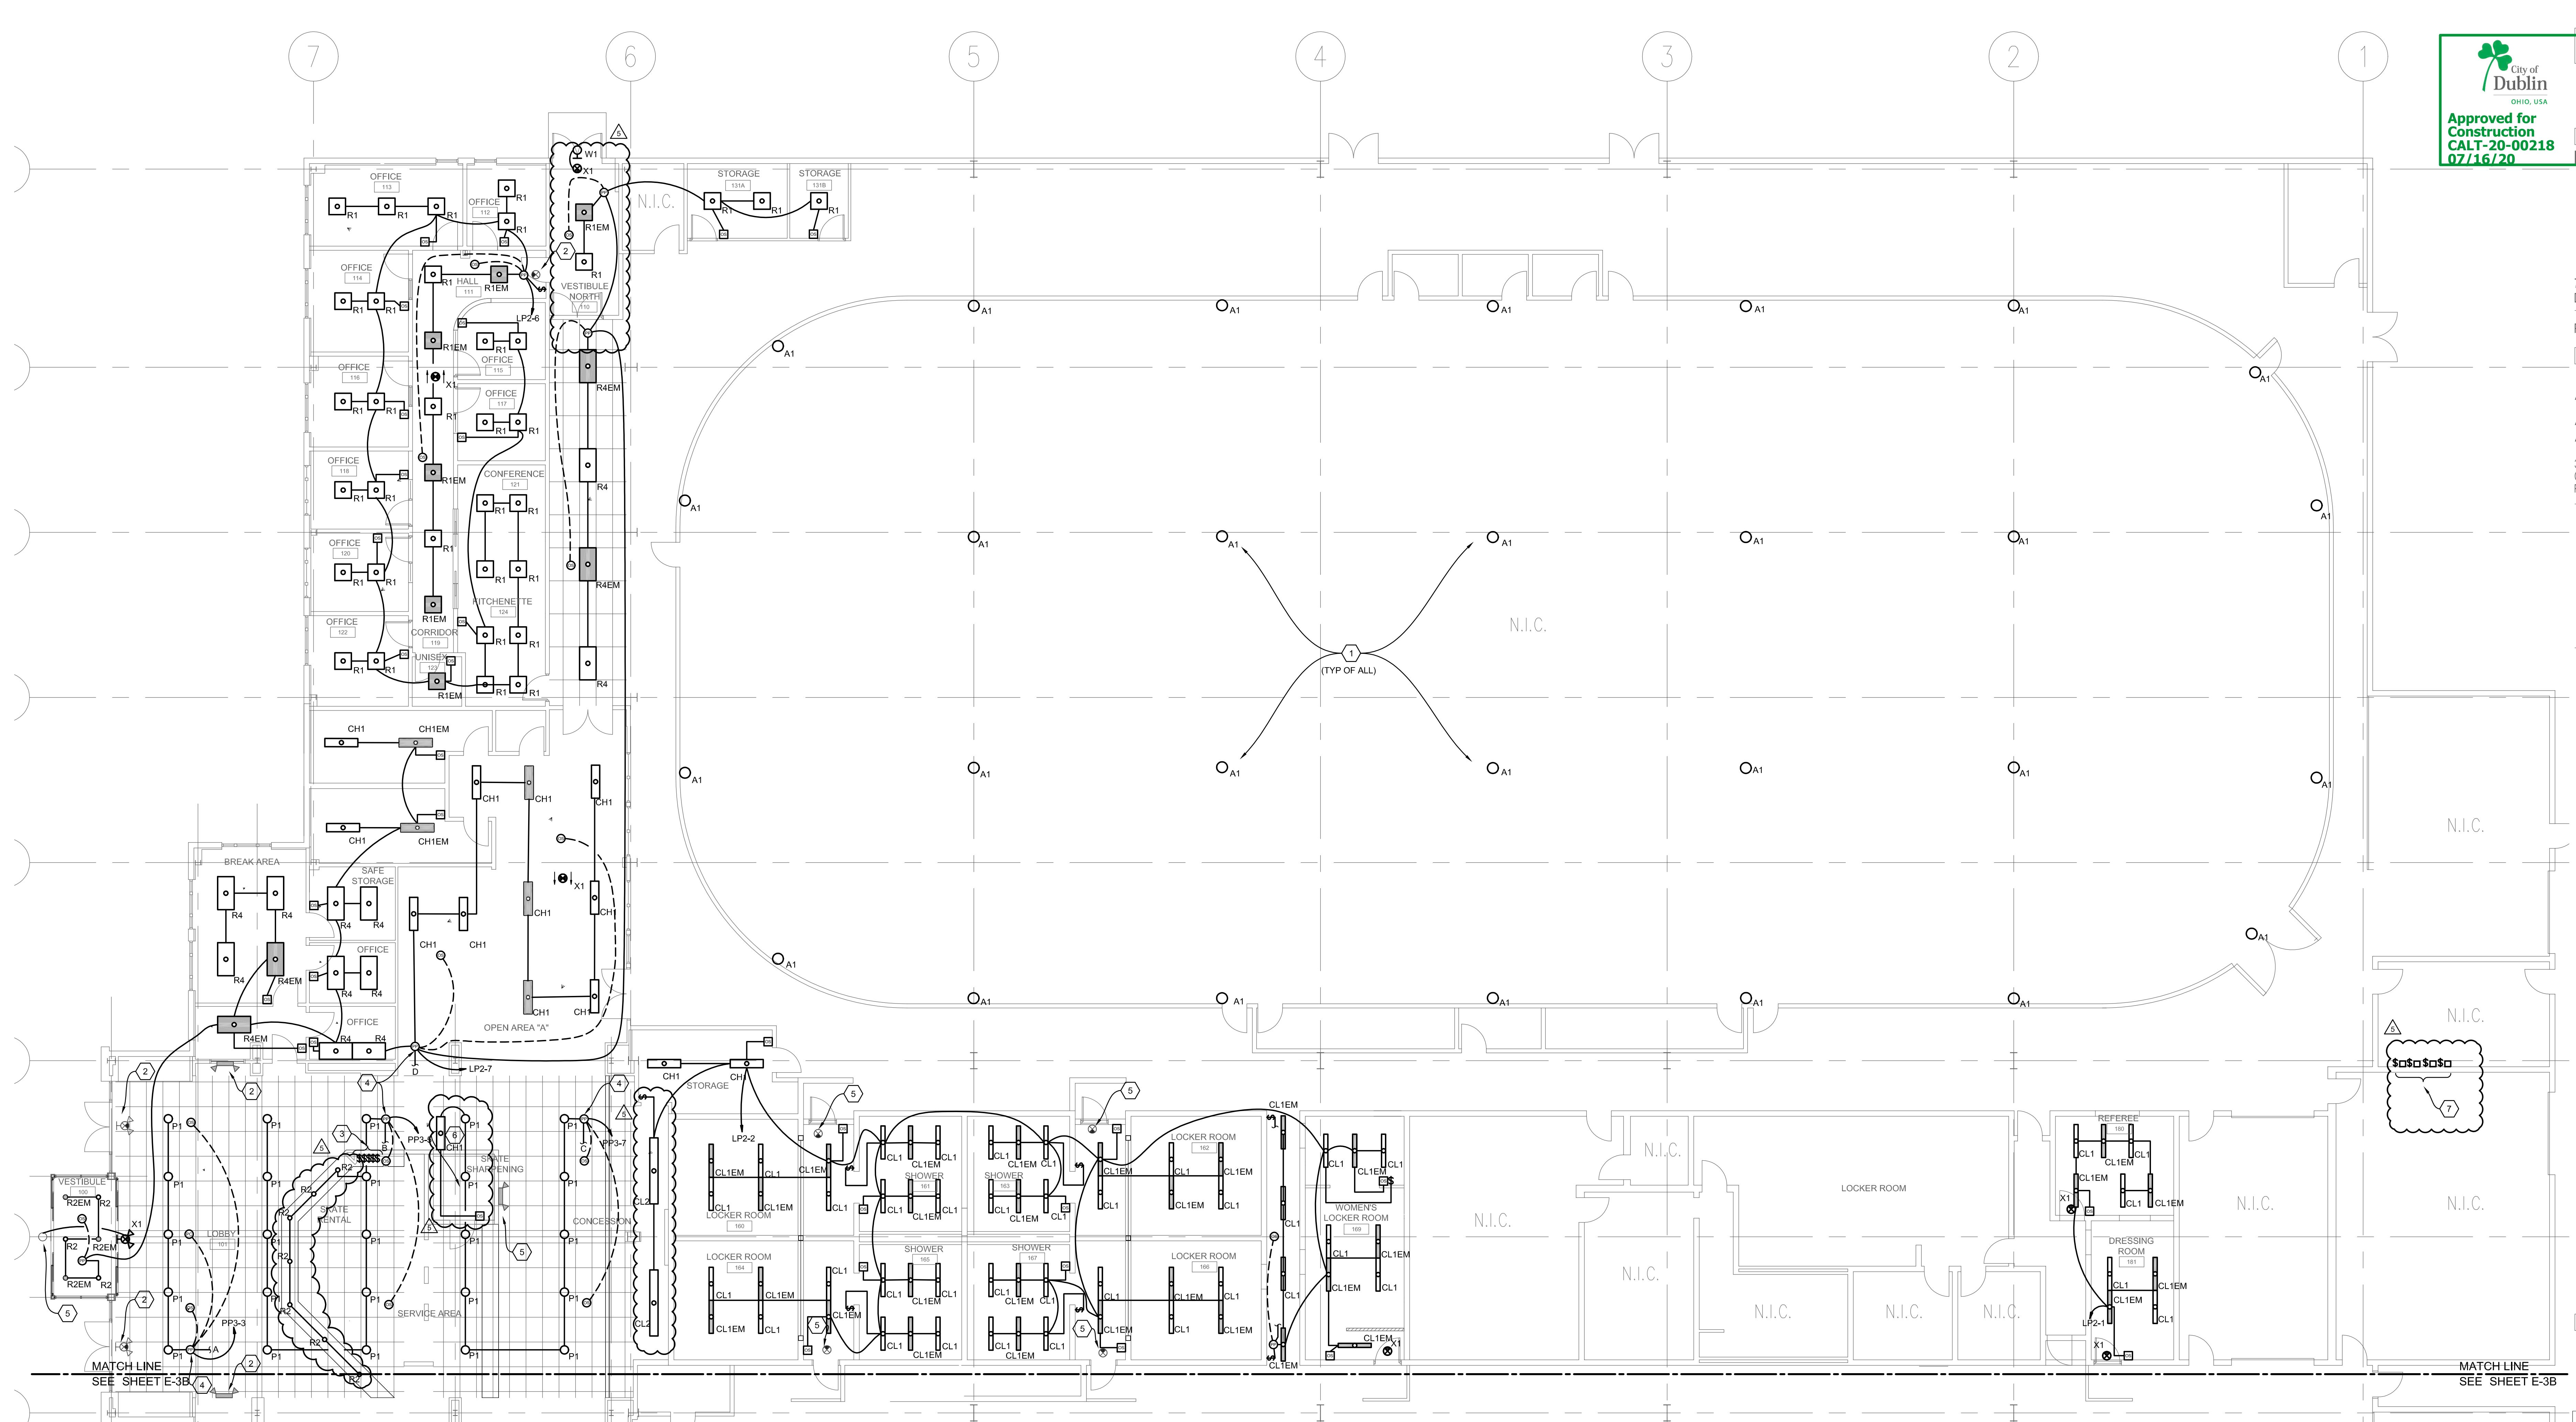

REVISIONS

REVISIONS

NUMBER	DATE	NUMBER	DATE
1	02/27/2020		
2	04/17/2020		
3	05/14/2020		
5	06/19/2020		

BUILDING DEPARTMENT COMMENT NOTES:
SCREEN ALL SERVICE STRUCTURES AND MECHANICAL UNITS PER DUBLIN CITY CODE.

E3A


$$\frac{1}{8}'' = 1'-0''$$


1. CONTACTORS
PROVIDE SQUARE D MODEL 8903 ELECTRICALLY
HELD CONTACTOR IN NEMA 1 ENCLOSURE WITH
POLE QUANTITY AS INDICATED. COORDINATE
EXACT LOCATION IN THE FIELD.

RINK LIGHTING CONTACTOR SCHEMATICS
N.T.S.

N.T.S.

- LIGHTING GENERAL NOTES:

- a. CONNECT ALL EMERGENCY FIXTURES TO THE LOCAL LIGHTING CIRCUIT AHEAD OF ALL SWITCHING. PROVIDE WITH 90 MINUTES OF EMERGENCY BATTERY BACKUP.

 CODED NOTES:

- 1 NEW LED RINK LIGHTS TO REPLACE EXISTING FIXTURES. CONNECT TO EXISTING WIRING.
- 2 EXISTING EXIT SIGNS TO REMAIN.
- 3 FRONT DESK LOBBY LIGHTING SWITCH BANK.
- 4 TO FRONT DESK LOBBY LIGHTING SWITCH BANK.

- | | |
|---|--|
| 5 | EXISTING LIGHT FIXTURE TO BE RELOCATED TO THIS LOCATION. |
| 6 | NEW CEILING MOUNTED LINEAR FIXTURE IN THE SKATE SHARPENING ROOM. |
| 7 | CONTACTORS FOR CONTROL OF RINK LIGHTS AND ASSOCIATED CONTROL SWITCHES. CONTROL SWITCHES SHALL BE CLEARLY LABELED TO IDENTIFY WHICH LIGHTS THEY CONTROL. SEE RINK LIGHTING CONTACTOR SCHEMATICS" ON THIS SHEET FOR ADDITIONAL CIRCUITING INFORMATION. COORDINATE EXACT LOCATION IN THE FIELD. |

BUILDING DEPARTMENT COMMENT NOTES:

SCREEN ALL SERVICE STRUCTURES AND MECHANICAL UNITS PER DUBLIN CITY CODE.